


- SHEET NOTES:
1. VERIFY SEAL WATER DISCHARGE ARRANGEMENT WITH PUMP MANUFACTURER PRIOR TO INSTALLING DRAIN PIPING.
 2. ALL UNDER SLAB PIPING SHALL BE CAST IRON OR DUCTILE PIPE. IF CAST IRON PIPE IS USED, PROVIDE TRANSITION COUPLING (ROMAC 501 OR EQUAL) AS CLOSE TO WET WELL WALL AS POSSIBLE.

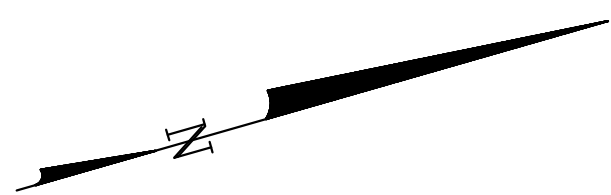

1 DRAIN AND VENT PLAN
BH-9 SCALE: 1/4" = 1'-0"

REVISIONS		
NO.	DATE	DESCRIPTION
1	10/11/2012	ISSUED FOR VALUE ENGINEERING REVIEW NO. 1
2	11/15/2012	ISSUED FOR OWNER PRELIMINARY REVIEW
3	11/29/2012	ISSUED FOR VALUE ENGINEERING REVIEW AND PRICING
4	01/07/2013	ISSUED FOR BUILDING PERMIT SUBMITTAL TO PPHSD (BIOLOGICAL HANDLING COMPLEX)
5	03/14/2013	ISSUED FOR CONSTRUCTION PER PPHSD BLDG PERMIT #65132 (BIOLOGICAL HANDLING COMPLEX)

THIS DRAWING IS THE PROPERTY OF GMS, INC., AND IS NOT TO BE RE-PRODUCED, MODIFIED OR USED FOR ANY OTHER PROJECT OR EXTENSION OF THIS PROJECT EXCEPT BY AGREEMENT WITH THIS COMPANY.

© 2012 GMS, INC.

DRAIN AND VENT PLAN
HAROLD D. THOMPSON REGIONAL WATER RECLAMATION FACILITY
LOWER FOUNTAIN METROPOLITAN SEWAGE DISPOSAL DISTRICT

DRAWN SKC
DESIGNED MAM
CHECKED RJS
DATE SEPTEMBER 2012
PROJECT NO. 20166.382
GMS FILE NO. 2599

GMS, INC.
CONSULTING ENGINEERS
611 N. WEBER, SUITE 300
COLORADO SPRINGS, COLORADO 80903

SHEET
BH-9
OF
—

XREF FILENAME: G:\
BASE DWG: G:\
PLOT STYLE FILE: 10SSC.DWG
FILENAME: G:\FMSSD\20166\382\BH9\BH9.DWG