


G:\JUNSD\2016\330\E19\19-10.dwg, 1/7/2011 4:31:01 PM, g:\j\dwg to pdf, 1:1

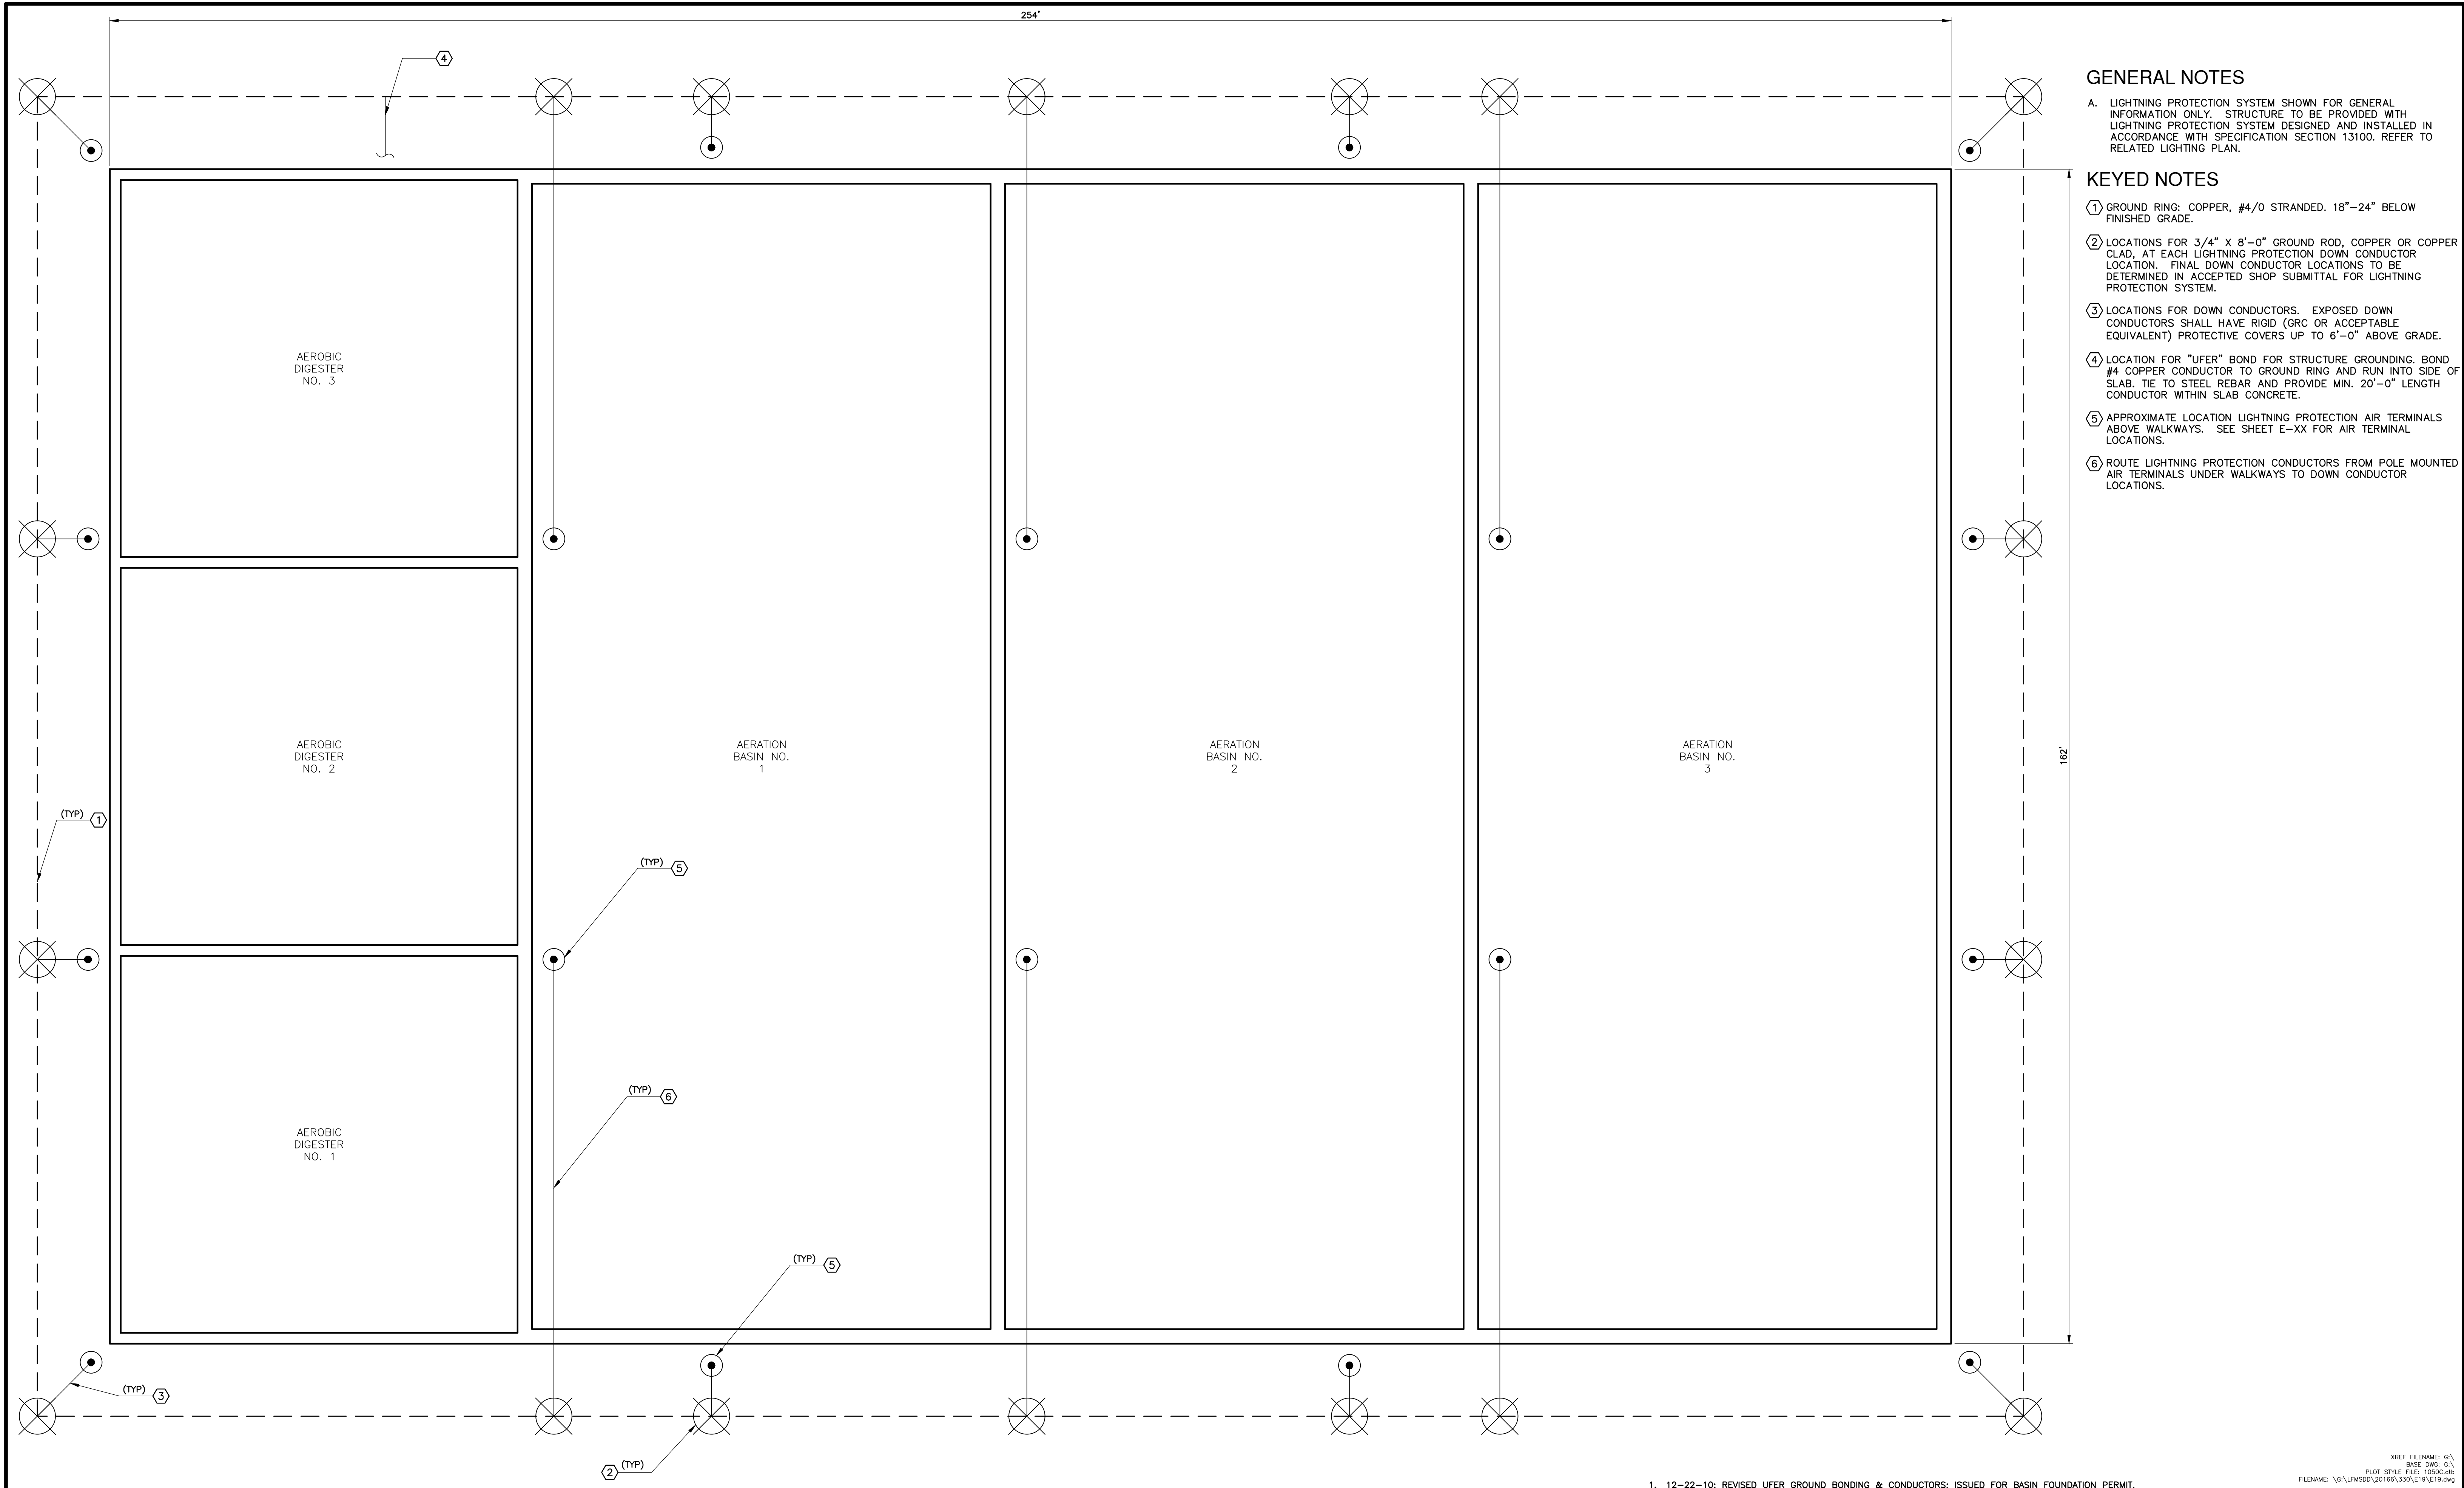

GENERAL NOTES

A. LIGHTNING PROTECTION SYSTEM SHOWN FOR GENERAL INFORMATION ONLY. STRUCTURE TO BE PROVIDED WITH LIGHTNING PROTECTION SYSTEM DESIGNED AND INSTALLED IN ACCORDANCE WITH SPECIFICATION SECTION 13100. REFER TO RELATED LIGHTING PLAN.

KEYED NOTES

- ① GROUND RING: COPPER, #4/0 STRANDED. 18"-24" BELOW FINISHED GRADE.
- ② LOCATIONS FOR 3/4" X 8'-0" GROUND ROD, COPPER OR COPPER CLAD, AT EACH LIGHTNING PROTECTION DOWN CONDUCTOR LOCATION. FINAL DOWN CONDUCTOR LOCATIONS TO BE DETERMINED IN ACCEPTED SHOP SUBMITTAL FOR LIGHTNING PROTECTION SYSTEM.
- ③ LOCATIONS FOR DOWN CONDUCTORS. EXPOSED DOWN CONDUCTORS SHALL HAVE RIGID (GRC OR ACCEPTABLE EQUIVALENT) PROTECTIVE COVERS UP TO 6'-0" ABOVE GRADE.
- ④ LOCATION FOR "UFER" BOND FOR STRUCTURE GROUNDING. BOND #4 COPPER CONDUCTOR TO GROUND RING AND RUN INTO SIDE OF SLAB. TIE TO STEEL REBAR AND PROVIDE MIN. 20'-0" LENGTH CONDUCTOR WITHIN SLAB CONCRETE.
- ⑤ APPROXIMATE LOCATION LIGHTNING PROTECTION AIR TERMINALS ABOVE WALKWAYS. SEE SHEET E-XX FOR AIR TERMINAL LOCATIONS.
- ⑥ ROUTE LIGHTNING PROTECTION CONDUCTORS FROM POLE MOUNTED AIR TERMINALS UNDER WALKWAYS TO DOWN CONDUCTOR LOCATIONS.

XREF FILENAME: G:\
BASE DWG: G\
PLOT STYLE FILE: 10502.ctb
FILENAME: G:\JUNSD\2016\330\E19\E19.dwg

1. 12-22-10: REVISED UFER GROUND BONDING & CONDUCTORS; ISSUED FOR BASIN FOUNDATION PERMIT.

REVISIONS		
NO.	DATE	DESCRIPTION
2	01/07/2011	ISSUED FOR CONSTRUCTION PER PPRBD PERMIT #58954 (FDN ONLY)

THIS DRAWING IS THE PROPERTY OF GMS, INC., AND IS NOT TO BE RE-PRODUCED, MODIFIED OR USED FOR ANY OTHER PROJECT OR EXTENSION OF THIS PROJECT EXCEPT BY AGREEMENT WITH THIS COMPANY.

© 2010 GMS, INC.

ELECTRICAL GROUNDING PLAN
AERATION BASINS AND AEROBIC DIGESTER BASINS
HAROLD D. THOMPSON REGIONAL WATER RECLAMATION FACILITY
LOWER FOUNTAIN METROPOLITAN SEWAGE DISPOSAL DISTRICT

DRAWN: XXX
DESIGNED: XXX
CHECKED: XXX
DATE: 2010
PROJECT NO.: 20166.330
GMS FILE NO.: 2599

GMS, INC.
CONSULTING ENGINEERS
611 N. WEBER, SUITE 300
COLORADO SPRINGS, COLORADO 80903

SHEET
E-19
OF
—

1 ELECTRICAL GROUNDING PLAN
E-19 SCALE: SCALE: 1" = 10'