


- GENERAL NOTES**
- UNDERGROUND CONDUIT PLAN MAY NOT SHOW ALL UNDERGROUND RUNS. SEE EBB-1 GENERAL NOTES.
 - UNDERGROUND CONDUIT FROM EXTERIOR RUNS SHALL BE RUN UNDER FOUNDATION. NO FOOTER WALL PENETRATIONS.
 - PROVIDE PULL CORD IN ALL SPARE CONDUIT RUNS.
 - VERIFY MOUNTING AND CONDUIT LOCATION ARRANGEMENTS FOR BLOWERS, VARIABLE FREQUENCY DRIVES, AND HARMONIC FILTERS WITH EQUIPMENT SUPPLIERS PRIOR TO ROUGH-IN. THE ARRANGEMENTS SHOWN ON THIS DRAWING ARE ESTIMATED.

- KEYED NOTES**
- PUMPING AND DISINFECTION (PD) BUILDING FEEDER AND SCADA/COMM NETWORK FROM EM BUILDING: (4) 2.5\"/>

1 BLOWER BUILDING UNDERGROUND CONDUIT PLAN
 EBB-2 SCALE: 1/4"=1'-0"

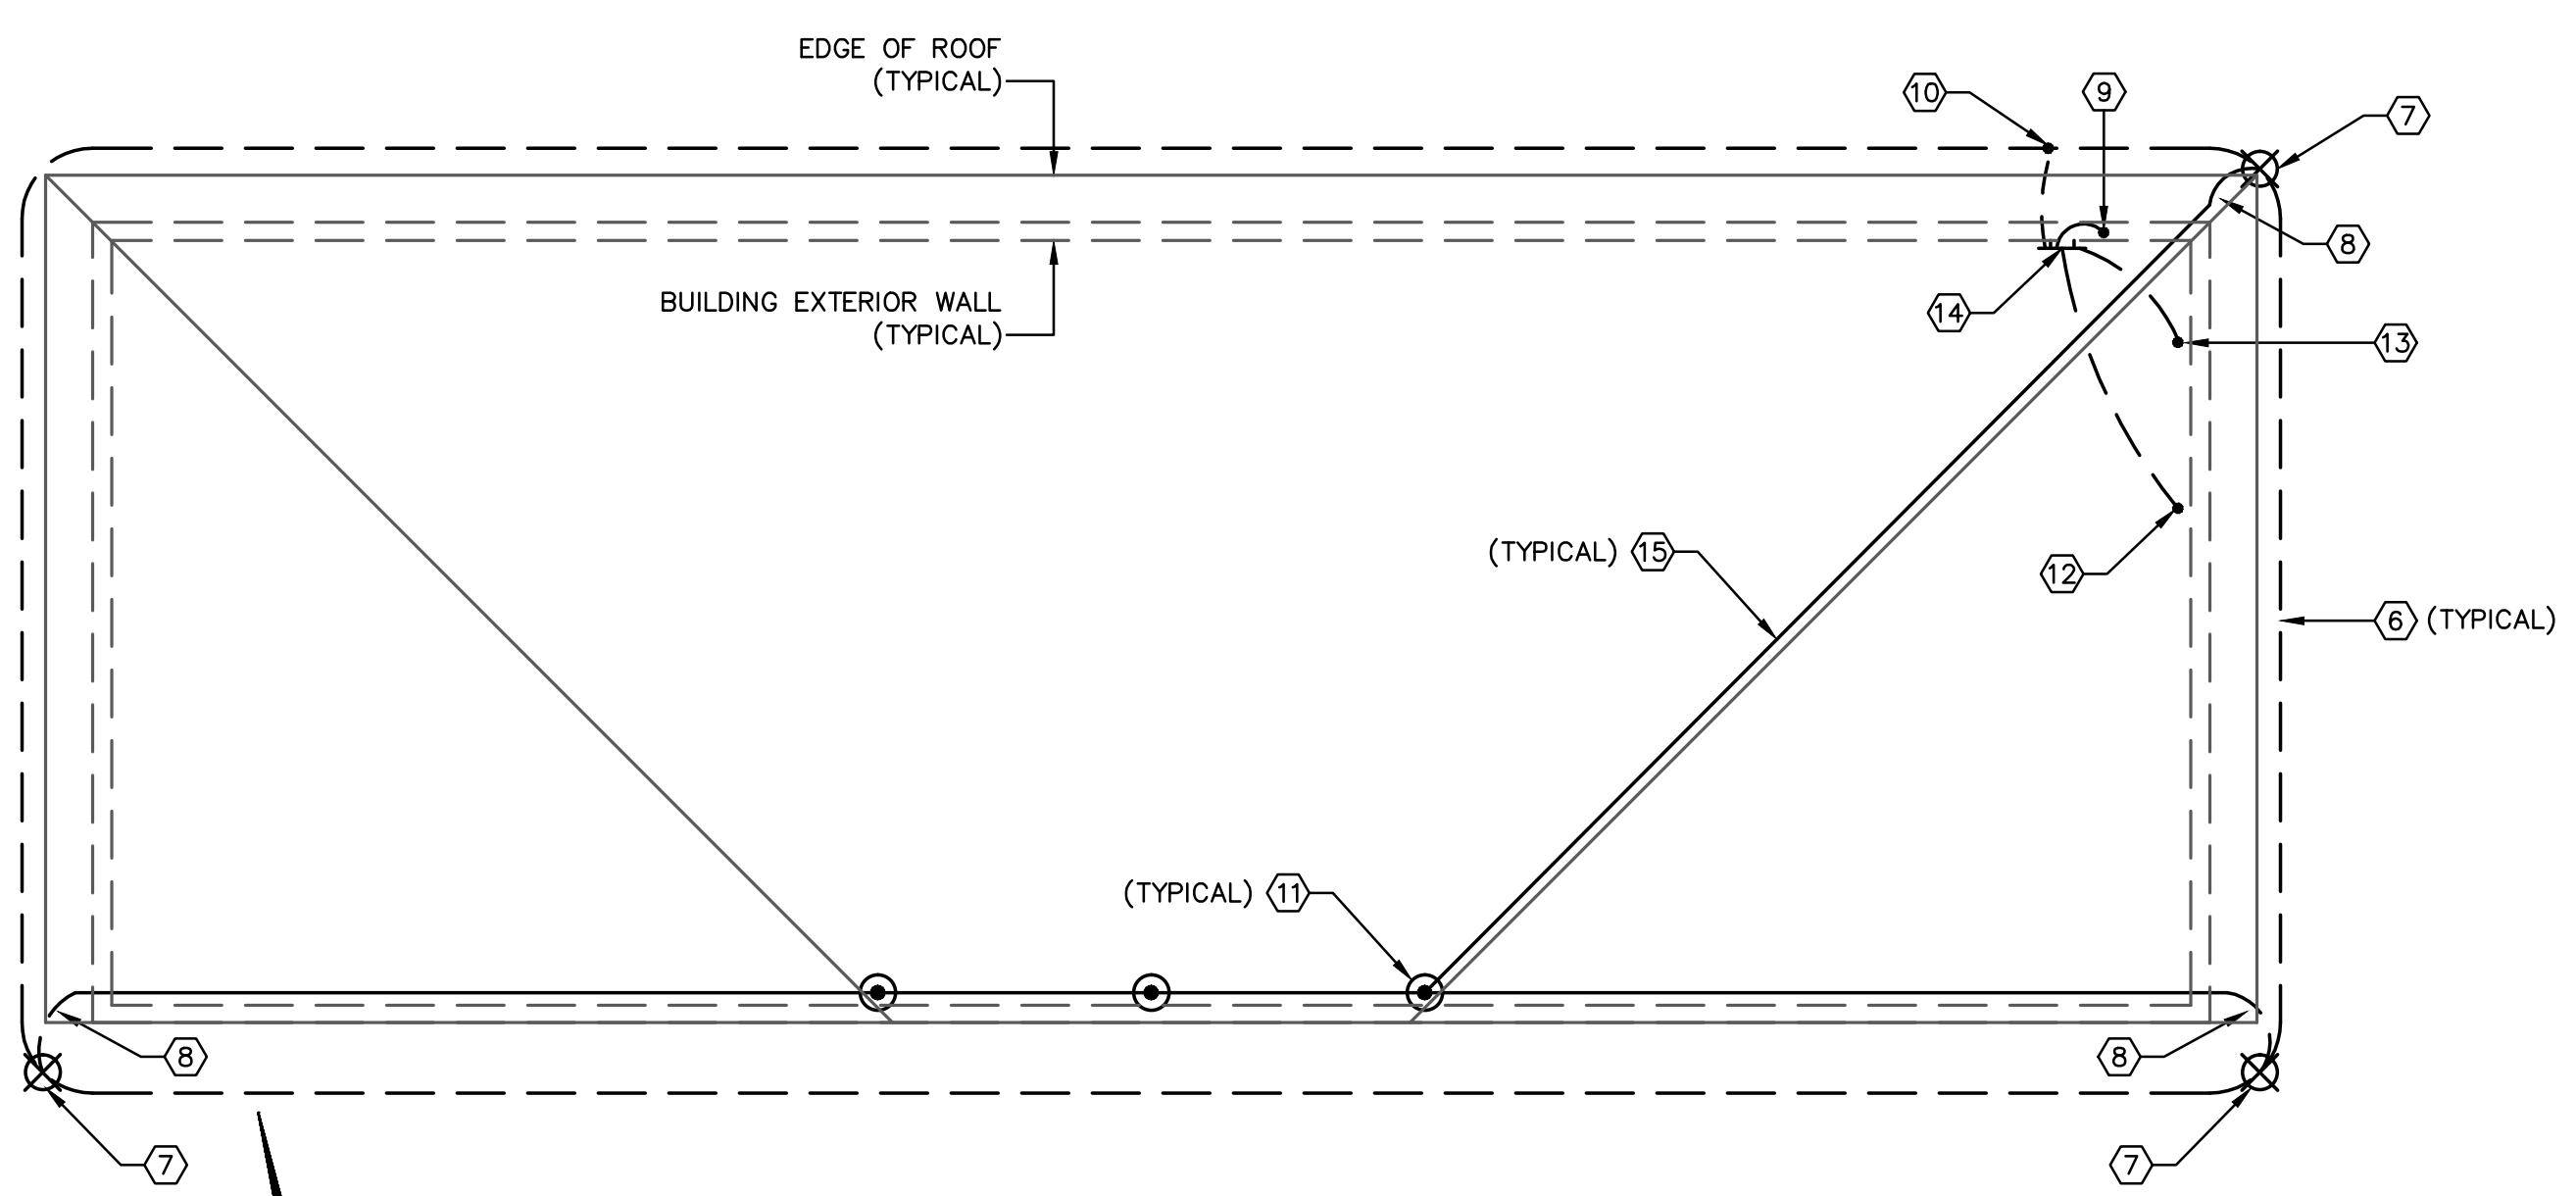

2 BLOWER BUILDING LIGHTNING PROTECTION PLAN
 EBB-2 SCALE: 1/8"=1'-0"

REVISIONS		
NO.	DATE	DESCRIPTION
1	06/21/2012	ISSUED FOR BUILDING PERMIT SUBMITTAL TO PPRBD (BLOWER BUILDING)
2	07/17/2012	ISSUED FOR CONSTRUCTION PER PPRBD BLDG PERMIT NO. 129081 (BLOWER BLDG)

THIS DRAWING IS THE PROPERTY OF GMS, INC., AND IS NOT TO BE REPRODUCED, MODIFIED OR USED FOR ANY OTHER PROJECT OR EXTENSION OF THIS PROJECT EXCEPT BY AGREEMENT WITH THIS COMPANY.

UNDERGROUND CONDUIT AND LIGHTNING PROTECTION PLANS		SHEET EBB-2 OF —
BLOWER BUILDING		
HAROLD D. THOMPSON REGIONAL WATER RECLAMATION FACILITY LOWER FOUNTAIN METROPOLITAN SEWAGE DISPOSAL DISTRICT		
DRAWN DESIGNED CHECKED DATE PROJECT NO. GMS FILE NO.	MR/MAM MR MR 2012 20166.330 2599	GMS, INC. CONSULTING ENGINEERS 611 N. WEBER, SUITE 300 COLORADO SPRINGS, COLORADO 80903

XREF FILENAME: G:\
 BASE DWG: G:\
 PLOT STYLE FILE: 10502.dwg
 FILENAME: \\g:\fms\ddp\20160\330\EBB2\EBB2.dwg