


**1 WATER PLAN-LOWER LEVEL**  
SCALE: 3/8" = 1'-0"

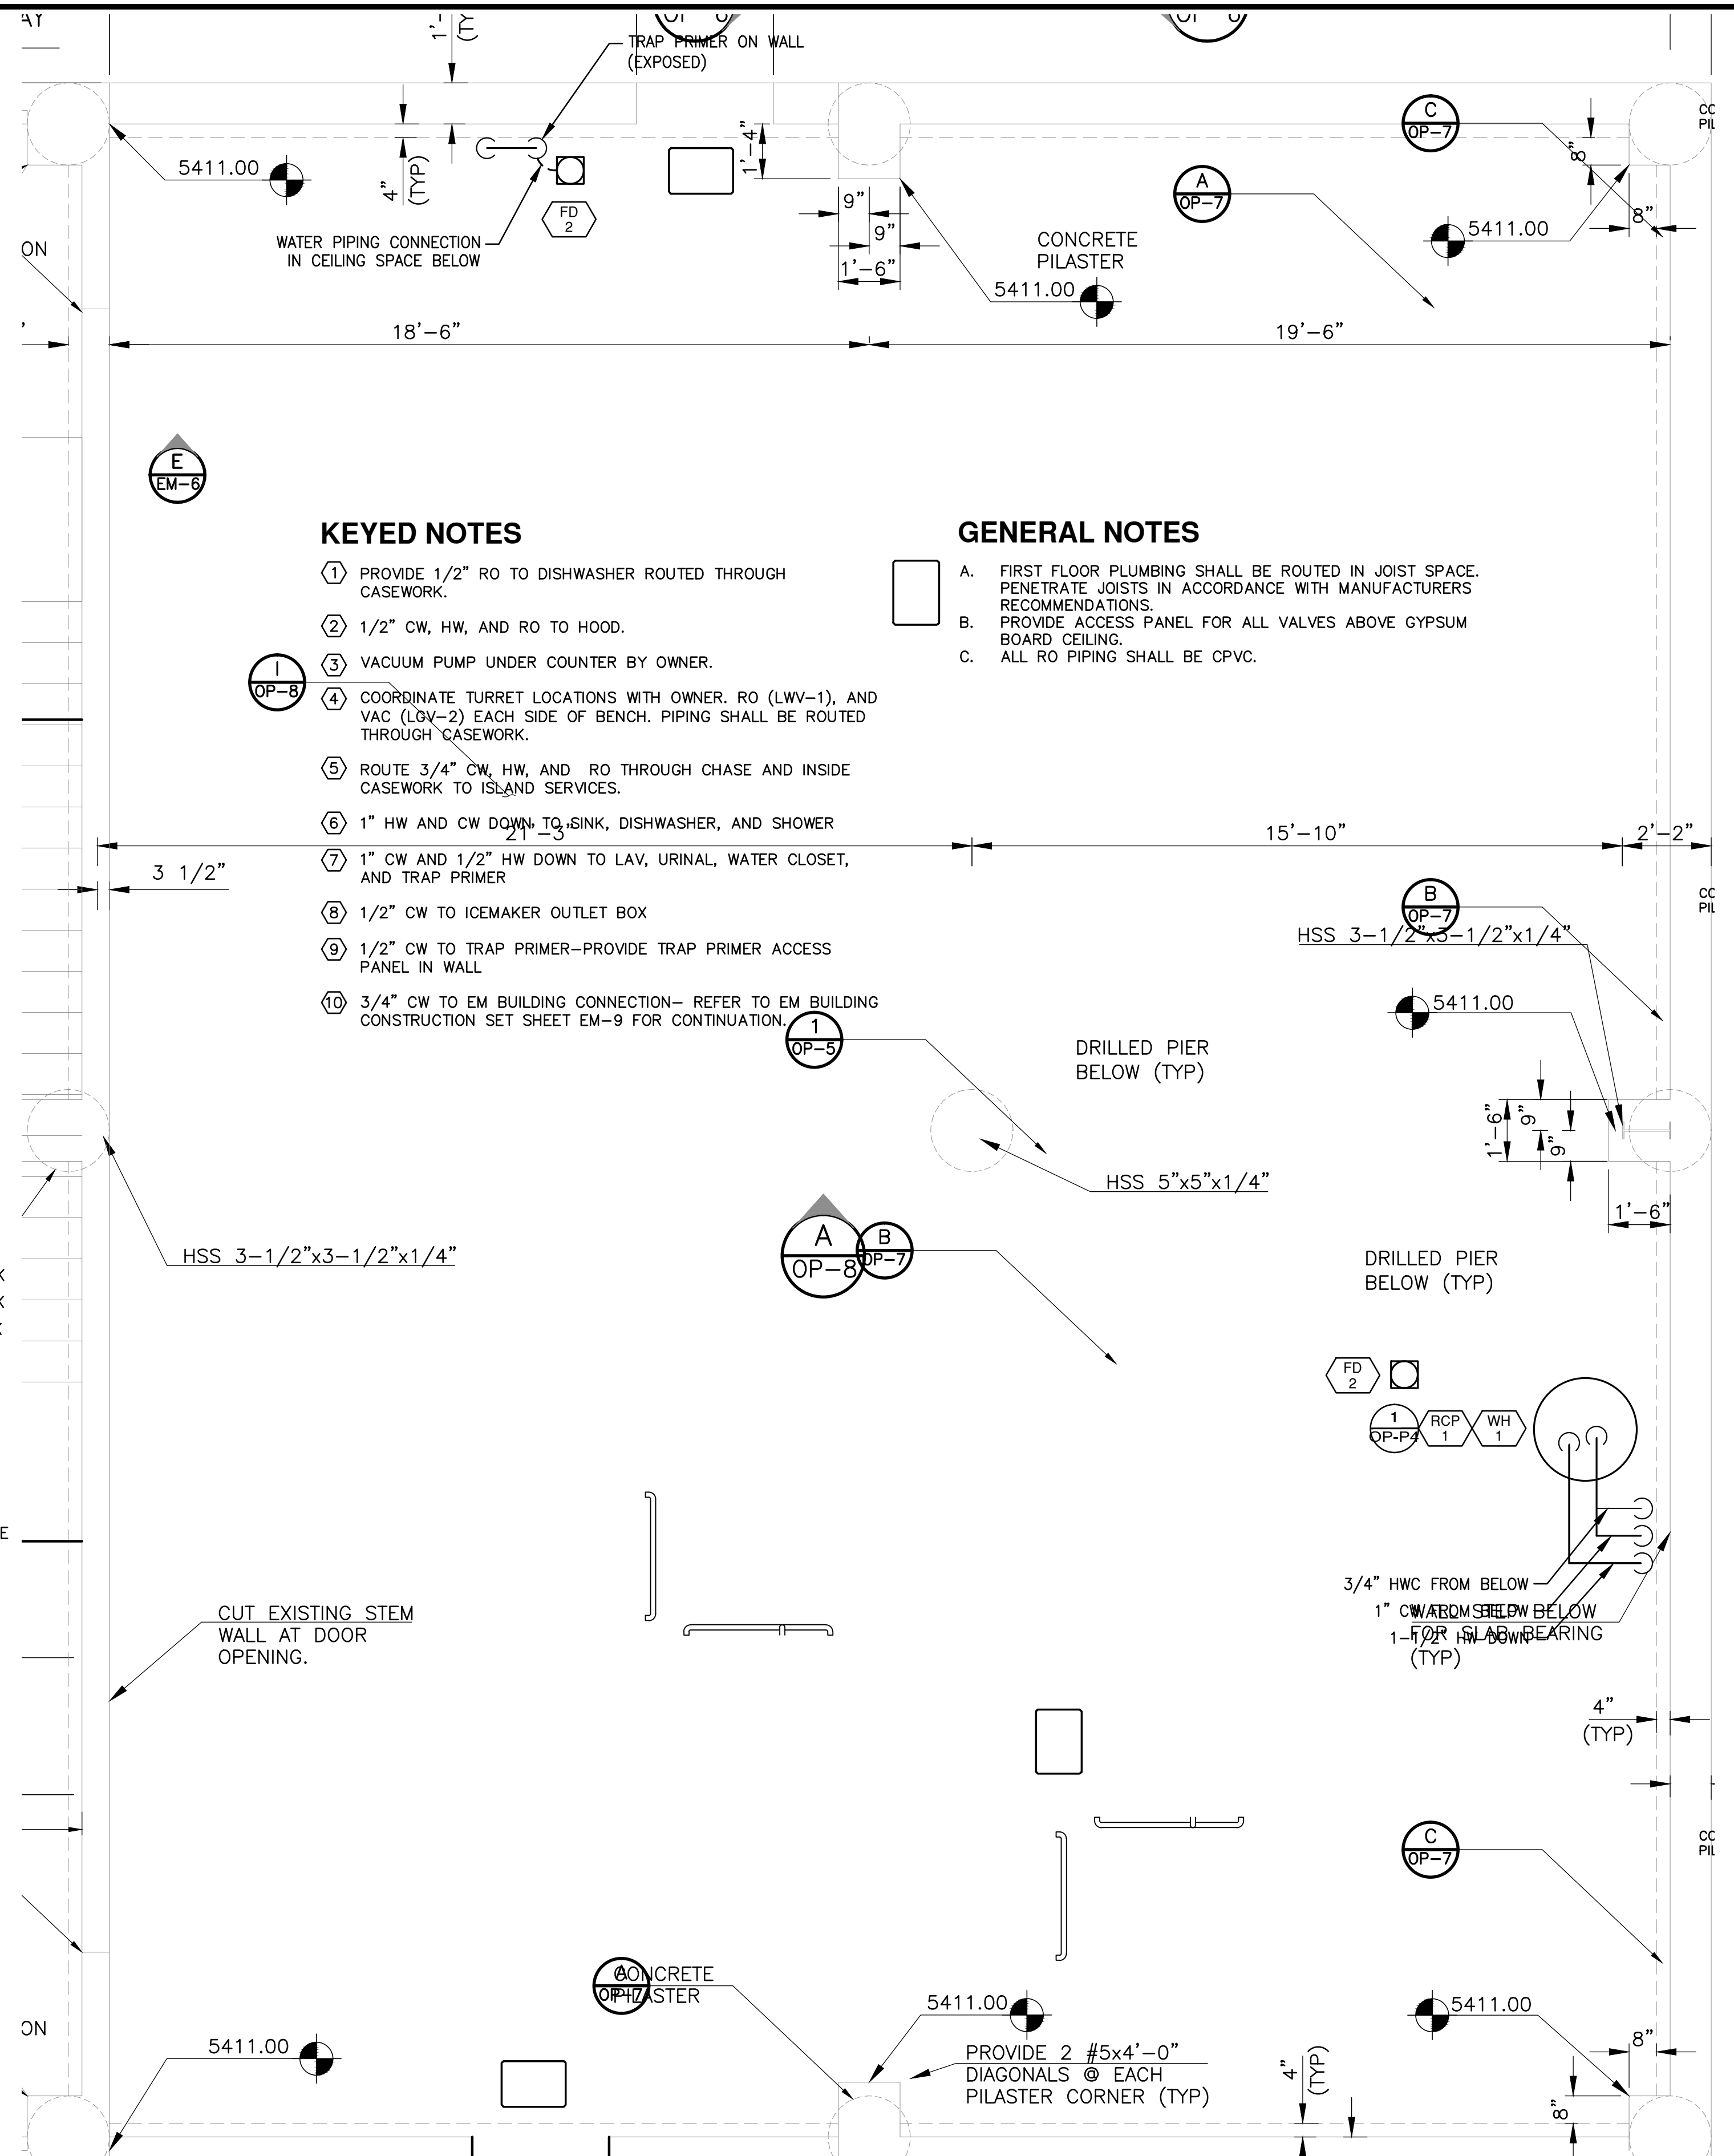

**2 WATER PLAN-UPPER LEVEL**  
SCALE: 3/8" = 1'-0"

**KEYED NOTES**

- 1 PROVIDE 1/2" RO TO DISHWASHER ROUTED THROUGH CASEWORK.
- 2 1/2" CW, HW, AND RO TO HOOD.
- 3 VACUUM PUMP UNDER COUNTER BY OWNER.
- 4 COORDINATE TURRET LOCATIONS WITH OWNER. RO (LWV-1), AND VAC (LOV-2) EACH SIDE OF BENCH. PIPING SHALL BE ROUTED THROUGH CASEWORK.
- 5 ROUTE 3/4" CW, HW, AND RO THROUGH CHASE AND INSIDE CASEWORK TO ISLAND SERVICES.
- 6 1" HW AND CW DOWN TO SINK, DISHWASHER, AND SHOWER
- 7 1" CW AND 1/2" HW DOWN TO LAV, URINAL, WATER CLOSET, AND TRAP PRIMER
- 8 1/2" CW TO ICEMAKER OUTLET BOX
- 9 1/2" CW TO TRAP PRIMER-PROVIDE TRAP PRIMER ACCESS PANEL IN WALL
- 10 3/4" CW TO EM BUILDING CONNECTION- REFER TO EM BUILDING CONSTRUCTION SET SHEET EM-9 FOR CONTINUATION

**GENERAL NOTES**

- A. FIRST FLOOR PLUMBING SHALL BE ROUTED IN JOIST SPACE. PENETRATE JOISTS IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS
- B. PROVIDE ACCESS PANEL FOR ALL VALVES ABOVE GYPSUM BOARD CEILING.
- C. ALL RO PIPING SHALL BE CPVC.

REVISIONS		
NO.	DATE	DESCRIPTION
1	06/29/2012	ISSUED FOR BUILDING PERMIT SUBMITTAL TO PPRBD (OPERATIONS BLDG)
2	07/18/2012	REISSUED FOR BUILDING PERMIT SUBMITTAL TO PPRBD (OPERATIONS BLDG)
3	08/15/2012	ISSUED FOR CONSTRUCTION PER PPRBD BUILDING PERMIT #135220 (OPERATIONS BLDG)

THIS DRAWING IS THE PROPERTY OF GMS, INC., AND IS NOT TO BE REPRODUCED, MODIFIED OR USED FOR ANY OTHER PROJECT OR EXTENSION OF THIS PROJECT EXCEPT BY AGREEMENT WITH THIS COMPANY.

**PLUMBING WATER PLAN**  
HAROLD D. THOMPSON REGIONAL WATER RECLAMATION FACILITY  
LOWER FOUNTAIN METROPOLITAN SEWAGE DISPOSAL DISTRICT

DRAWN SKC  
DESIGNED DRF  
CHECKED RJS  
DATE MAY 2012  
PROJECT NO. 20166.410  
GMS FILE NO. 2599

**GMS, INC.**  
CONSULTING ENGINEERS  
611 N. WEBER, SUITE 300  
COLORADO SPRINGS, COLORADO 80903

SHEET  
**OP-P2**  
OF  
—